



Flange Mount Enclosure Detailed Drawings


CBS - 15 - 125 Amp

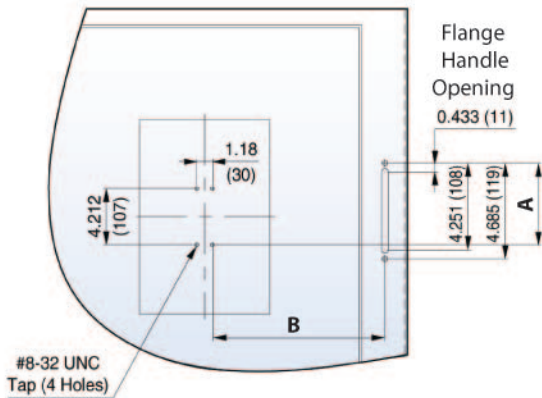


CBS - 150 - 250 Amp

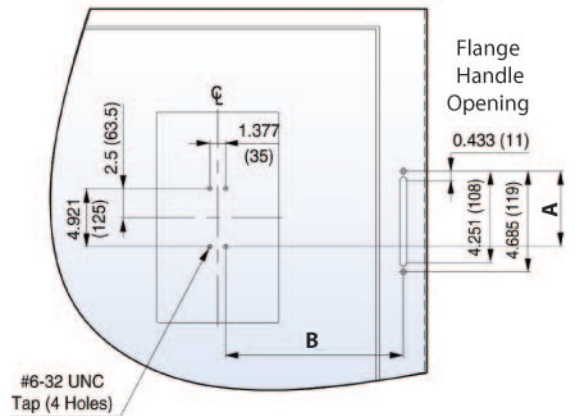


CBS - 300 - 400 Amp

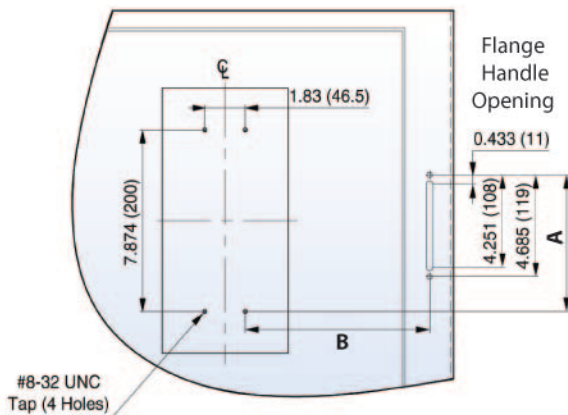

CBS - 500 - 800 Amp

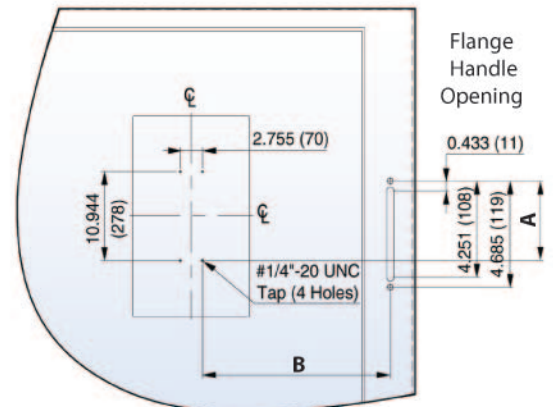

| Table 1 | Maximum "b" Dimension | | Table 2 | Maximum "A" Dimension | | | |
|---------|-----------------------|------------|---------|-----------------------|-----------|-----|-----------|
| | Enclosure Depth | CBS FHK-60 | | Enclosure Depth | 60" cable | | 72" cable |
| | | CBS FHK-72 | | Up | Down | Up | Down |
| 10" | 25" | 30" | 10" | 17" | 31" | 20" | 34" |
| 12" | 24" | 29" | 12" | 17" | 31" | 19" | 33" |
| 16" | 23" | 28" | 16" | 17" | 28" | 19" | 30" |
| 18" | 22" | 27" | 18" | 17" | 28" | 19" | 30" |
| 20" | 21" | 26" | 20" | 16" | 26" | 18" | 28" |
| 24" | 20" | 25" | 24" | 14" | 26" | 16" | 28" |
| 30" | 19" | 24" | 30" | 11" | 24" | 13" | 26" |
| 36" | 18" | 23" | 36" | 6" | 21" | 8" | 22" |

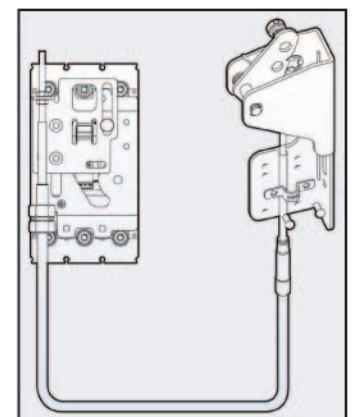

Above shows locations of the tapped holes required to mount the breakers as well as the flange mount opening for the enclosure.

Detailed location of the breaker is listed in the chart above.

Above Dimensions shown in inches (mm)