


Electrical auxiliaries

Possible configuration of electrical auxiliaries

Maximum possibilities

Phase	Accessory	CBS-1	CBS-2	CBS-4	CBS-8
R (Left)	AX	-	1	3	3
	AL	1	1	-	-
	SNT or UVT	1	1	1	1
T (Right)	AX	2	1	-	-
	AL	-	-	1	2

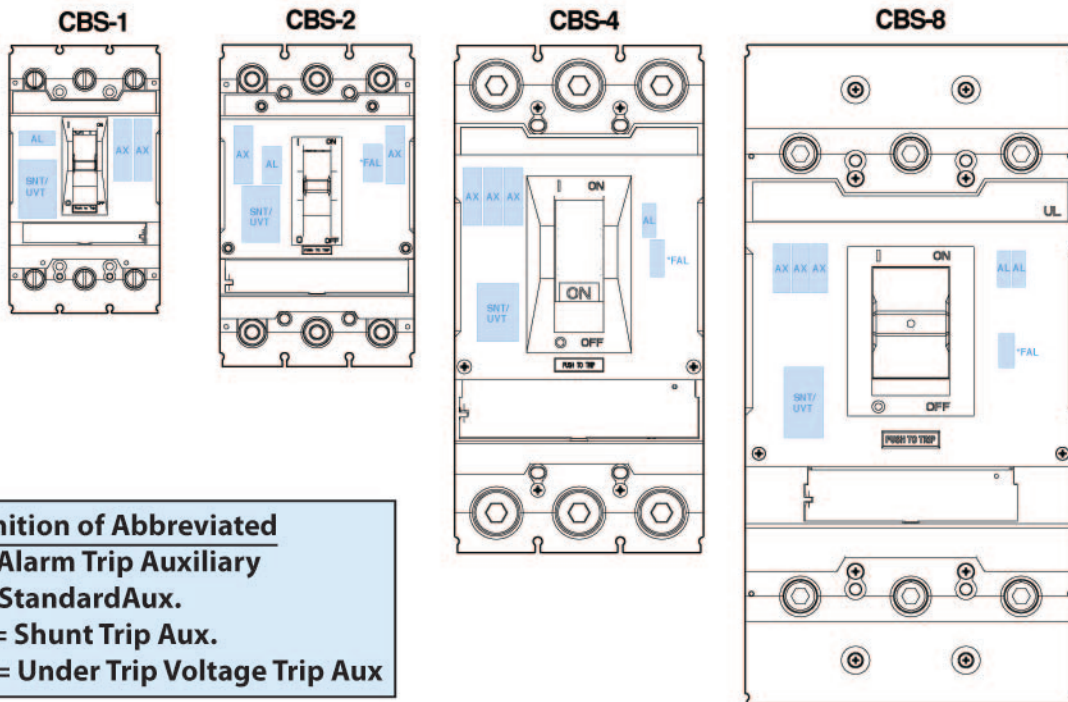

Definition of Abbreviated

AL= Alarm Trip Auxiliary

AX= StandardAux.

SNT= Shunt Trip Aux.

UVT= Under Trip Voltage Trip Aux

* The above possible accessory configurations are for all 3 modles. CBS*S, CBS* H, CBS * S ADJ